

VISUAL COMFORT AND COMPANY TEST REPORT

SCOPE OF WORK

LED Performance Testing

MODEL NUMBER

EC2RS-158354DN-UNV-W

PROJECT NUMBER

G104941221

REPORT NUMBER

104941221CHI-074

ISSUE DATE

9/9/2022

REVISED DATE

None

TEST DATES

2022-08-31 through 2022-09-09.

DOCUMENT CONTROL NUMBER

RTTDS-R-AMER-Test-3407

© 2017 INTERTEK



REPORT NUMBER

104941221CHI-074

MODEL NUMBER(s)

EC2RS-158354DN-UNV-W

REPORT RENDERED TO:

VISUAL COMFORT AND COMPANY
7400 LINDER AVE
SKOKIE, IL 60077
USA

STATEMENT OF LIMITATION

NVLAP Lab Code 600186-0. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government.

AUTHORIZATION

The testing performed was authorized by signed quote number Qu-01236637-1.

TEST STANDARDS


IESNA LM-79 - 2008: Electrical and Photometric Measurements of Solid State Lighting

ANSI/IES LM-79-19 Optical and Electrical Measurements of Solid-State Lighting Products

ANSI NEMA ANSLG C78.377: 2017: Specifications for the Chromaticity of Solid State Lighting (SSL) Products

IES TM-30-18: IES Method for Evaluating Light Source Color Rendition

In Charge of Testing:



Steven Nguyen
Engineer
Lighting Division

Reviewer:



Jeff Davis
N.A. Technical Lead
Lighting Division

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

SAMPLE INFORMATION

REPORT NO. 104941221CHI-074

ITEMS RECEIVED

Item No.	Control No.	Model No.	Description	Type	Received
1	AH08252022081536	EC2RS-158354DN-UNV-W	2" DOWNLIGHT LUMINAIRE	Production	8/25/2022

TESTED SAMPLE CONFIGURATIONS

Config No.	Tested Model No.	Item Nos. Utilized
1	EC2RS-158354DN-UNV-W	1

SAMPLE PHOTOS - TESTED CONFIGURATIONS



SUMMARY

REPORT NO. 104941221CHI-074

PRODUCT INFORMATION AND SUMMARY OF DATA

Product Model No.:	EC2RS-158354DN-UNV-W
Product Description:	2" DOWNLIGHT LUMINAIRE
LED Model No.:	Bridgelux / BXRE-35E1000-C-81
Driver Model No.:	ERP / PTB20W-0400-38-VCC
Light Source:	LED

Criteria	Results	
	Goniophotometer	Integrating Sphere
Light Output (lumens)	1433.2	1358.9
Input Power (W) @ 120VAC (Vac)	14.95	14.91
Lumen Efficacy (lm/W)	95.9	91.1
Input Power Factor (PF) @ 120VAC (Vac)	0.984	0.985

Criteria	Results
Input ATHD (%) @ 120VAC (Vac)	15.05
Correlated Color Temperature (K)	3590
Color Rendering Index - Ra (I)	82.2
Color Rendering Index - R9 (I)	11.4
Duv (I)	-0.0006
Chromaticity Coordinate (x)	0.400
Chromaticity Coordinate (y)	0.387
Chromaticity Coordinate (u')	0.234
Chromaticity Coordinate (v')	0.509

TEST METHODS

SEASONING IN SAMPLE ORIENTATION - LED PRODUCTS

No seasoning was performed in accordance with IESNA LM-79.

INTEGRATING SPHERE TESTING

A spectroradiometer and integrating sphere were used to measure the spectral distribution for each EUT resulting in photometric and colorimetric data. Electrical measurements of the unit were measured using a power analyzer. Each EUT was operated at the rated input voltage of the system in its designated orientation. The ambient temperature was measured at a position inside the sphere and stabilization procedures to LM-79 were followed.

TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING

A Type C Mirror Goniophotometer system was used to measure the luminous intensity (candela) at each angle of distribution for the EUT. Electrical measurements of the unit were measured using a power analyzer. Each EUT was operated at the rated input voltage of the system in its designated orientation. The ambient temperature was measured at a position near the EUT at equal height and stabilization procedures to LM-79 were followed.

TYPE C GONIOPHOTOMETER DISTRIBUTION TESTING

REPORT NO. 104941221CHI-074

Test Configuration	Tested Model No.	Pass/Fail/NA
1	EC2RS-158354DN-UNV-W	NA

PHOTOMETRIC AND ELECTRICAL MEASUREMENTS (25°C +/- 1°C)


Base Orientation	Input Voltage (Vac)	Input Current (mA)	Input Power (W)	Input Power Factor ()
Up	120.00	126.6	14.95	0.984

Light Output (lm)	Lumen Efficacy (lm/W)
1433.2	95.9

INTENSITY SUMMARY - CANDELA


Angle	0	22.5	45	67.5	90
0	2798	2798	2798	2798	2798
5	2713	2682	2684	2693	2706
10	2446	2404	2414	2431	2452
15	1994	1949	1961	1999	2026
20	1426	1394	1417	1447	1472
25	886	862	883	903	913
30	476	451	462	481	484
35	230	218	224	230	229
40	113	102	103	106	107
45	49	47	46	48	49
50	26	24	24	24	25
55	14	13	13	13	14
60	9	9	9	9	9
65	6	6	6	6	7
70	2	2	2	2	2
75	2	1	1	2	2
80	1	1	1	1	1
85	0	0	0	0	0
90	0	0	0	0	0
95	0	0	0	0	0
100	0	0	0	0	0
105	0	0	0	0	0
110	0	0	0	0	0
115	0	0	0	0	0
120	0	0	0	0	0
125	0	0	0	0	0
130	0	0	0	0	0
135	0	0	0	0	0
140	0	0	0	0	0
145	0	0	0	0	0
150	0	0	0	0	0
155	0	0	0	0	0
160	0	0	0	0	0
165	0	0	0	0	0
170	0	0	0	0	0
175	0	0	0	0	0
180	0	0	0	0	0

Entire luminous intensity matrix found in .IES file

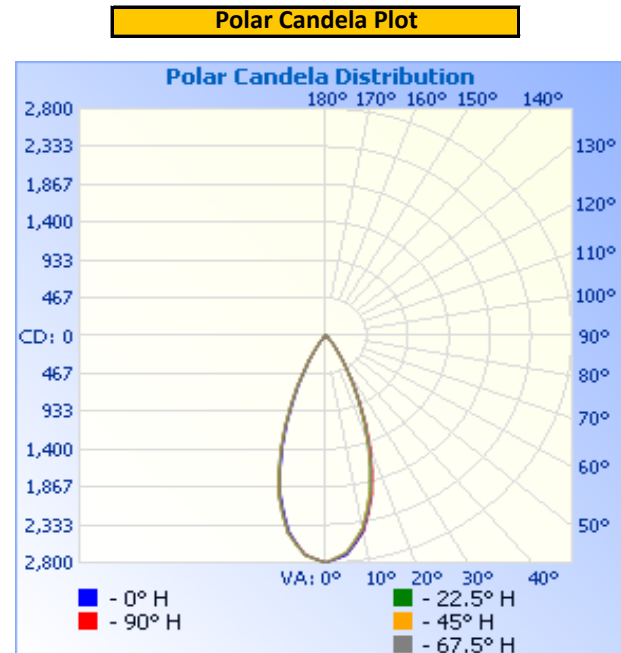

REPORT NO. 104941221CHI-074

ILLUMINANCE SUMMARY

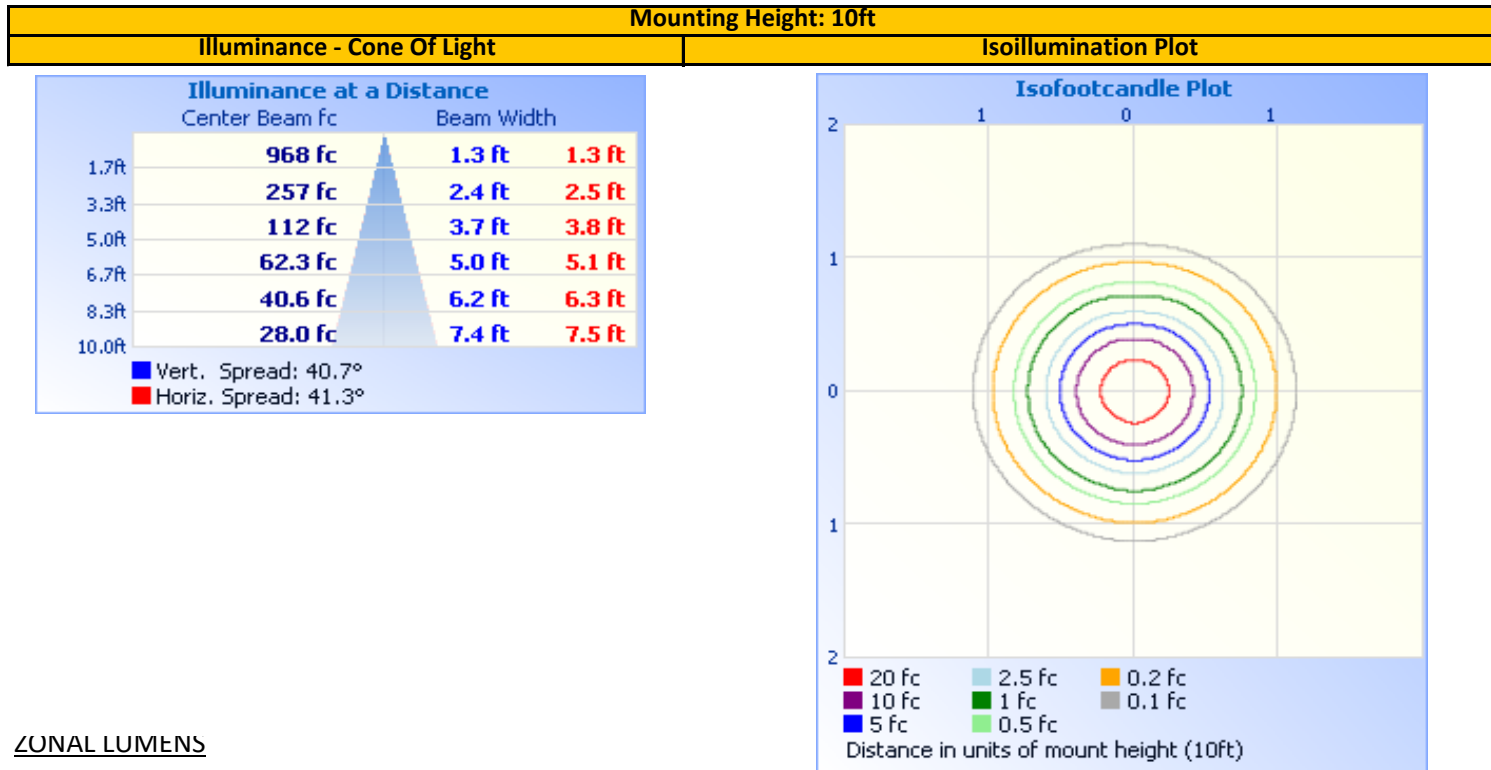

ZONAL LUMENS

Zonal Lumen Summary					
Zone	Lumens	Luminaire	Zone	Lumens	Total
0-30	1,211.7	84.5%	0-10	248.3	17.3%
0-40	1,368.5	95.5%	10-20	545.7	38.1%
0-60	1,425.1	99.4%	20-30	417.7	29.1%
60-90	8.1	0.6%	30-40	156.8	10.9%
70-100	2.1	0.1%	40-50	43.0	3.0%
90-120	0.0	0.0%	50-60	13.6	0.9%
0-90	1,433.2	100.0%	60-70	6.0	0.4%
90-180	0.0	0.0%	70-80	1.6	0.1%
0-180	1,433.2	100.0%	80-90	0.5	0.0%
			90-100	0.0	0.0%
			100-110	0.0	0.0%
			110-120	0.0	0.0%
			120-130	0.0	0.0%
			130-140	0.0	0.0%
			140-150	0.0	0.0%
			150-160	0.0	0.0%
			160-170	0.0	0.0%
			170-180	0.0	0.0%

INTEGRATING SPHERE TESTING

REPORT NO. 104941221CHI-074

Test Configuration	Tested Model No.	Pass/Fail/NA
1	EC2RS-158354DN-UNV-W	NA

PHOTOMETRIC, COLORIMETRIC, AND ELECTRICAL MEASUREMENTS (25°C +/- 1°C)


Base Orientation
Up

Input Voltage (Vac)	Input Current (mA)	Input Power (W)	Input Power Factor (l)	Input ATHD (%)
119.99	126.1	14.91	0.985	15.05

Measured at 119.99(Vac)

Light Output (lm)	Lumen Efficacy (lm/W)	CCT (K)	CRI - Ra (l)	CRI - R9 (l)
1358.9	91.1	3590	82.2	11.4

Duv (l)	1931 Chrom (x)	1931 Chrom (y)	1976 Chrom (u')	1976 Chrom (v')
-0.0006	0.400	0.387	0.234	0.509

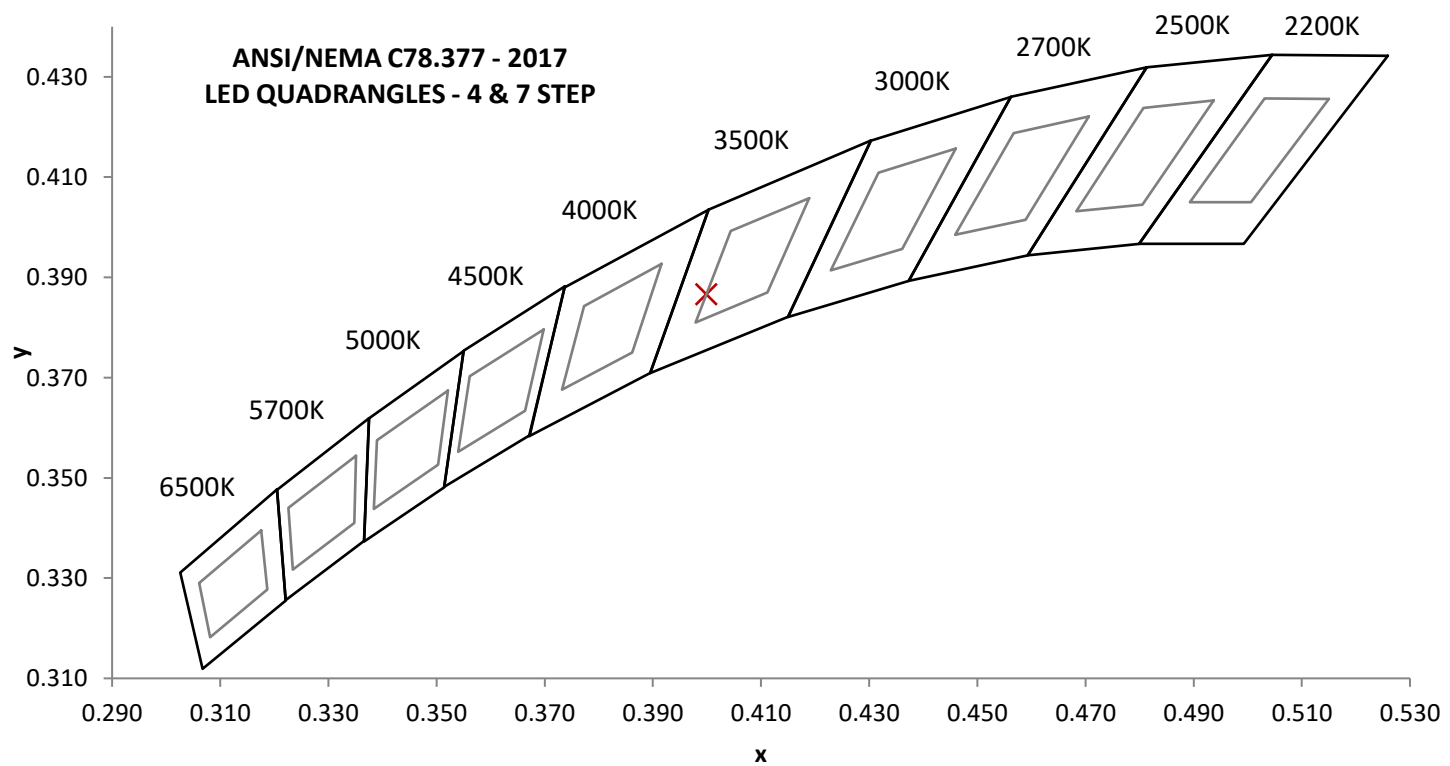


REPORT NO. 104941221CHI-074

SPECTRAL DISTRIBUTION OVER WAVELENGTHS

nm	mW/nm		nm	mW/nm		nm	mW/nm		nm	mW/nm
350	0.2		460	9.5		570	19.9		680	6.3
355	0.1		465	7.3		575	20.7		685	5.5
360	0.1		470	5.3		580	21.3		690	4.8
365	0.2		475	4.4		585	21.9		695	4.1
370	0.2		480	4.4		590	22.3		700	3.6
375	0.2		485	5.0		595	22.7		705	3.1
380	0.2		490	6.0		600	22.7		710	2.7
385	0.3		495	7.4		605	22.5		715	2.3
390	0.3		500	9.0		610	22.1		720	2.0
395	0.3		505	10.5		615	21.4		725	1.7
400	0.4		510	11.8		620	20.5		730	1.5
405	0.4		515	12.9		625	19.4		735	1.3
410	0.7		520	13.8		630	18.3		740	1.1
415	1.2		525	14.5		635	16.9		745	0.9
420	2.1		530	15.1		640	15.7		750	0.8
425	3.6		535	15.7		645	14.3		755	0.7
430	5.7		540	16.2		650	13.0		760	0.6
435	8.4		545	16.8		655	11.7		765	0.5
440	12.8		550	17.3		660	10.4		770	0.5
445	18.4		555	17.9		665	9.3		775	0.4
450	19.7		560	18.5		670	8.2		780	0.3
455	13.6		565	19.2		675	7.2		---	---

Without correction of sample absorption.

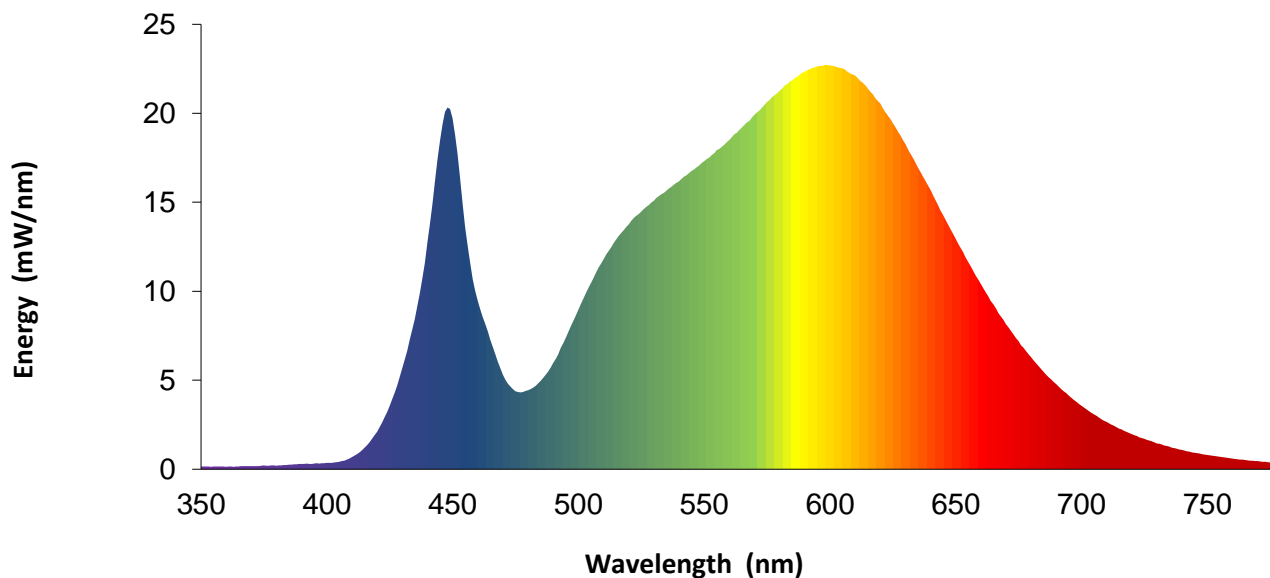

Portrayed color in graphic is estimated by wavelength (nm) and may not be exact - it is a visual representation only

EQUIPMENT LIST

REPORT NO. 104941221CHI-074

#	Equipment	Model No	Control No.	Last Cal	Cal Due
1	Yokogawa Power Meter	WT310E	CHI0664	3/30/2022	3/30/2023
2	Omega Thermometer	DPI8-C24	146920	10/4/2021	10/4/2022
3	LSI High Speed Mirror Goniometer	6440T	146928	VBU	VBU
4	Newport Thermohygrometer	iServer	CHI0452	2/3/2022	2/3/2023
5	Chroma Power Supply	61604	CHI0371	VBU	VBU
8	Newport Humidity Recorder	iServer	146961	9/21/2021	9/21/2022
9	Labsphere Spectroradiometer	CDS2600	CHI0539	VBU	VBU
10	3 Meter Sphere	SPR600	CHI0088	VBU	VBU
11	Elgar AC Power Supply	CW1251	146112	VBU	VBU
12	Sorenson DC Power Supply	XFR150-8	146846	VBU	VBU
13	Yokogawa Power Meter	WT1600	146769	4/5/2022	4/5/2023
17	Omega thermometer	USB TC08	EQAH002615	4/5/2022	4/5/2023
26	Xitron Power Analyzer	XT-2640	CHI0611	7/6/2022	7/6/2023

Note: Standard sources listed above are traceable to NIST: National Institute of Standards and Technology

REVISION HISTORY

#	Revision Date	Updated By	Reviewed By	Description of Change
---	None	---	---	---
---	---	---	---	---
---	---	---	---	---

Test Configuration	Tested Model No.	Pass/Fail/NA
1	EC2RS-158354DN-UNV-W	NA







ANSI/IES TM-30-18 Color Rendition Report

Source: User SPD

Manufacturer: VISUAL COMFORT AND COMPANY

Date: 8/31/2022

Model: EC2RS-158354DN-UNV-W

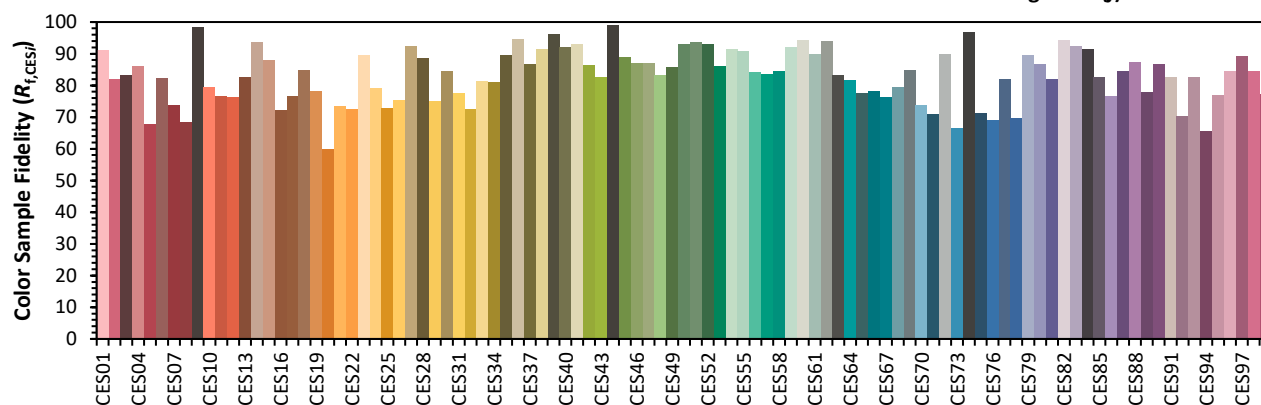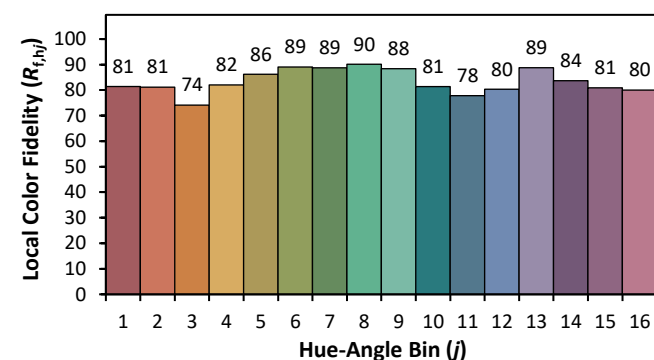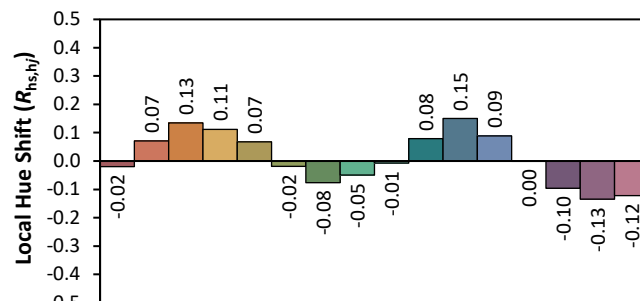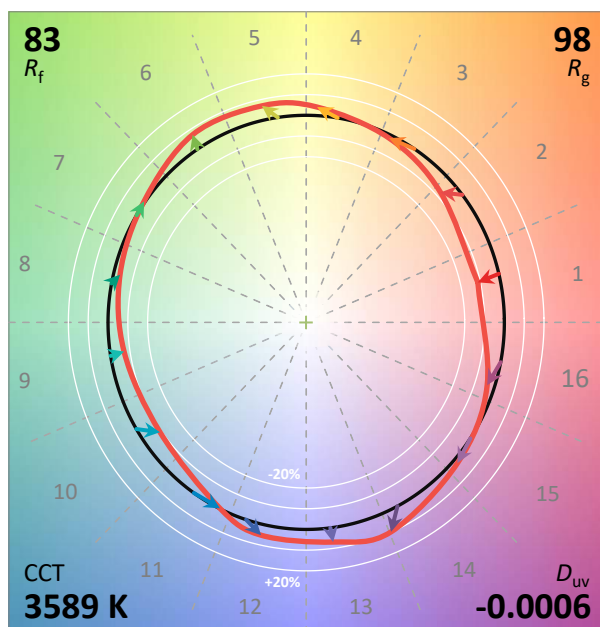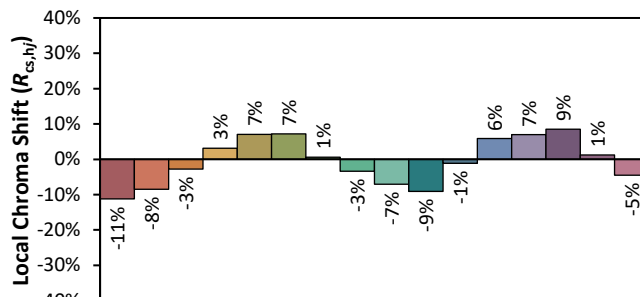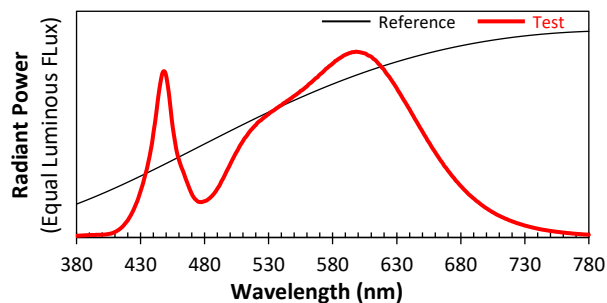

Notes: This is a recommended method for displaying ANSI/IES TM-30-18 information.

 x 0.3998 y 0.3866 u' 0.2338 v' 0.5087